


Study Area

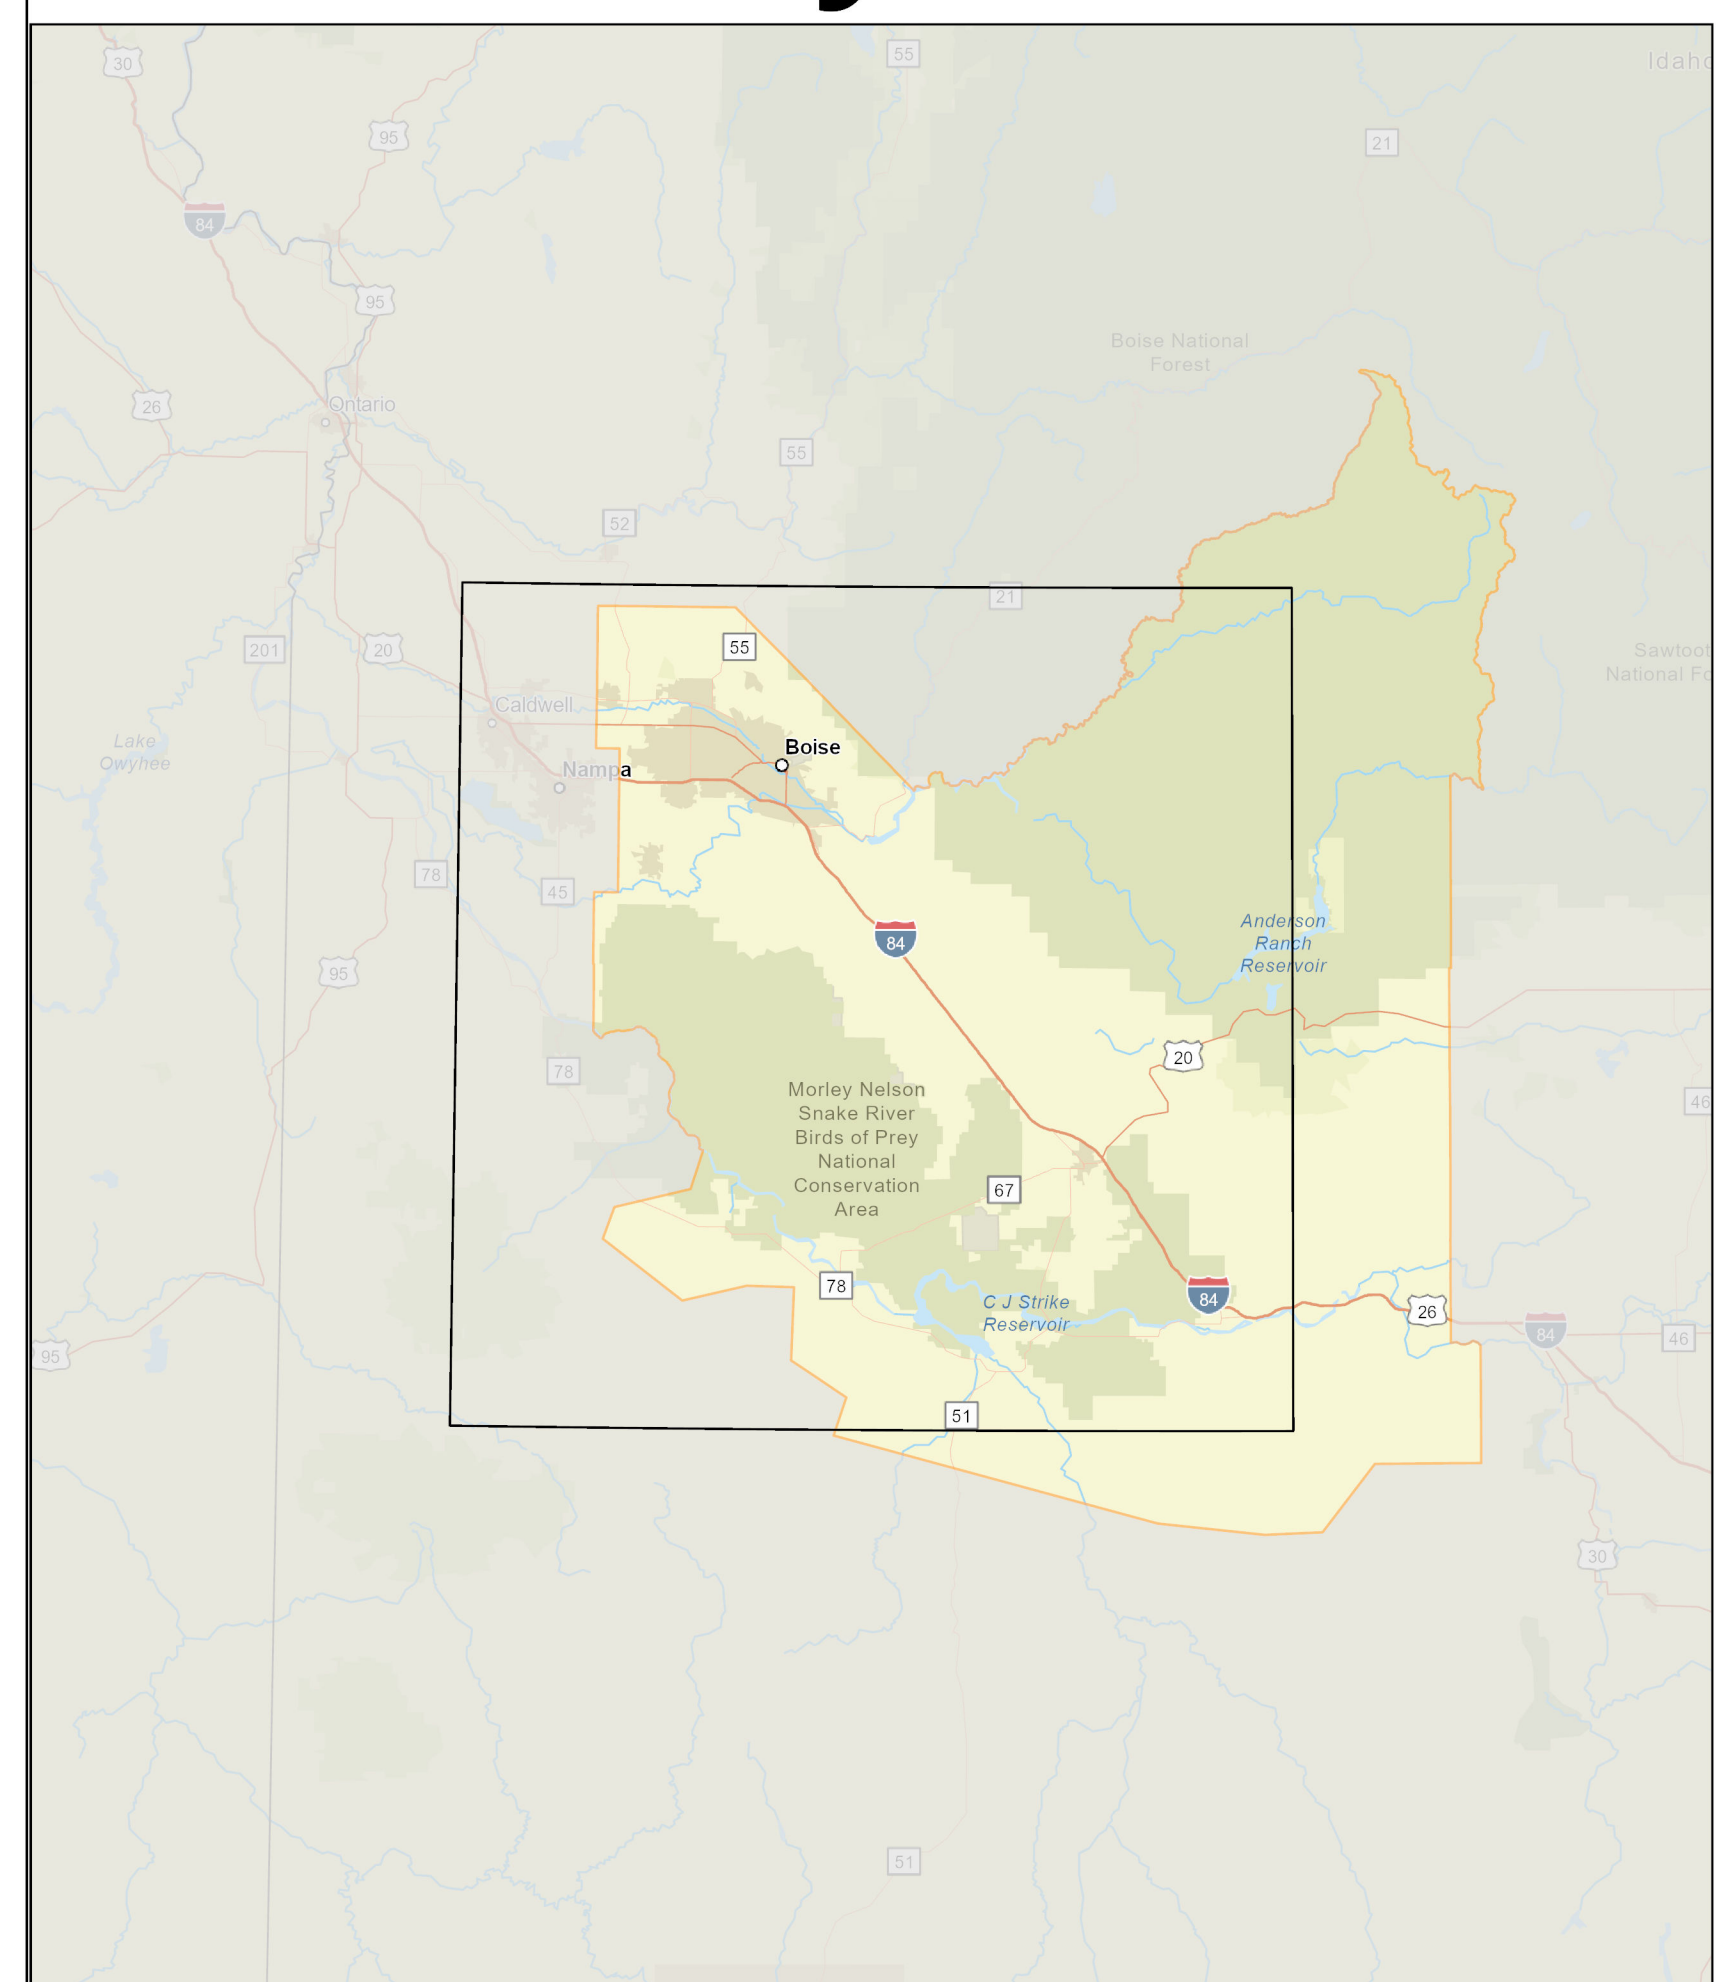

- Existing Transmission Line**
- 69kV
 - 138kV
 - 230kV
 - 500kV
- Pref. 138kV
..... Alt. 138kV
- Pref. Distribution Substation**
- ◆ Pref. Distribution Substation
 - ◆ Alt. Distribution Substation
- Legend**
- Pref. Source Substation
 - Alt. Source Substation
 - Existing Source Substation
 - Existing Distribution Substation

Eastern Treasure Valley Electrical Plan 2024

138kV

