


Study Area

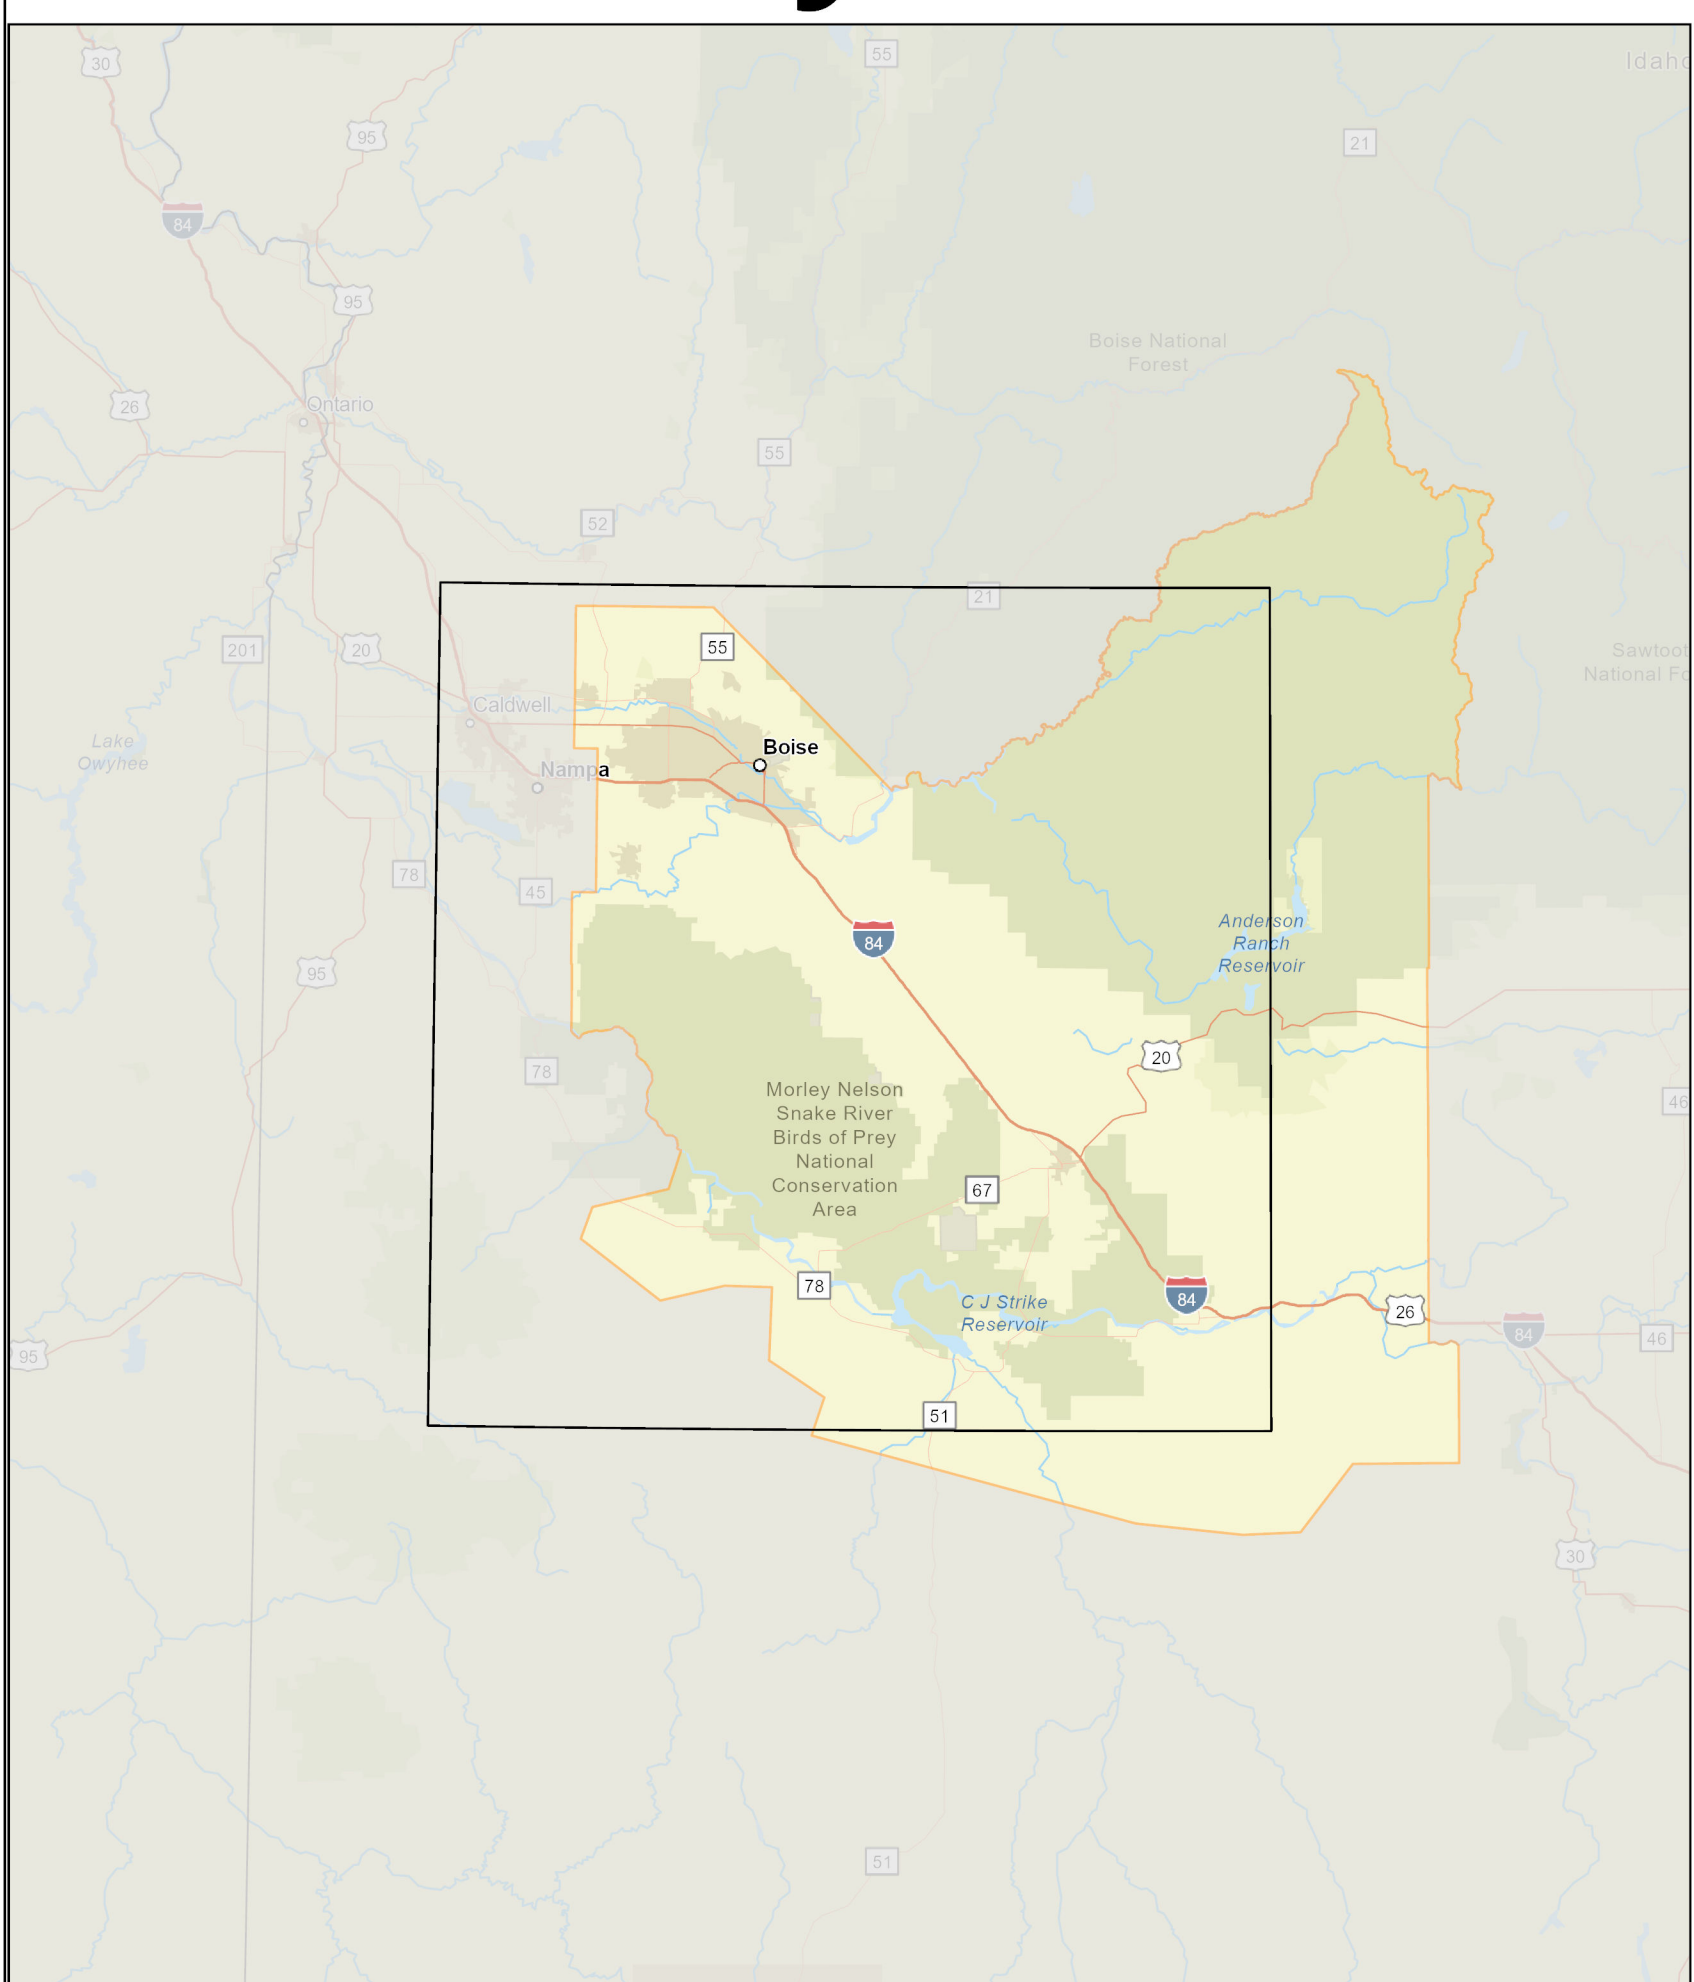

Existing Transmission Line
 69kV
 138kV
 230kV
 500kV

Legend

- Existing Source Substation
- Pref. Source Substation
- Alt. Source Substation
- ⋯ Preferred 230kV
- Alternate 230kV

**Eastern Treasure Valley
 Electrical Plan
 2024**

230kV

