

**GENERATOR INTERCONNECTION
SYSTEM IMPACT STUDY REPORT**

for integration of the proposed

**4.2 MW [REDACTED] PROJECT
IPC PROJECT QUEUE #752**

to the

IDAHO POWER COMPANY ELECTRICAL SYSTEM

for

[REDACTED]

REPORT v.0

January 31, 2025

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

Revision History

Date	Revision	Initials	Summary of Changes
1/31/2025	0	MAP	SIS GI #752 – Original issue.

4.2 MW [REDACTED] Project
System Impact Study Report

i

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

Table of Contents

1.0	Introduction.....	1
2.0	Summary	1
3.0	Scope of Interconnection Transmission System Impact Study.....	2
4.0	Description of Proposed Generating Project.....	3
5.0	Description of Transmission Facilities	3
6.0	Description of Power Flow Case	3
7.0	Power Flow Analysis Study Results	4
9.0	Description of Distribution Facilities.....	4
10.0	Short Circuit Study Results.....	5
11.0	Description of Required Facility Upgrades	5
12.0	Description of Operating Requirements	7
13.0	Conclusion	9
	APPENDIX A.....	10
	A-1.0 Method of Study	10
	A-2.0 Acceptability Criteria	10
	A-3.0 Grounding Guidance.....	11
	A-4.0 Electrical System Protection Guidance	11
	A-5.0 WECC Coordinated Off-Nominal Frequency Load Shedding and Restoration Requirements	11
	APPENDIX B.....	12

4.2 MW [REDACTED] Project
System Impact Study Report

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

List of Tables

Table 1: GI #752 Short Circuit Currents, POI.....	5
Table 2: Conceptual-level Primary POI Cost Estimate for GI #752	6

List of Figures

Figure 1: Operating Requirements (IEEE 1547-2018).....	7
Figure 2. Voltage-Reactive Power Settings (IEEE 1547-2018).....	8
Figure 3. Location of [REDACTED] Project – GI #752.....	12

1.0 Introduction

██████████ has contracted with Idaho Power Company (IPC) to perform a Generator Interconnection System Impact Study for the integration of the proposed 4.2 MW ██████████ project (the Project). The Project is located in IPC's Western Region near ██████████ ██████████ in Malheur County, Oregon (See Figure 3: Location of ██████████ Project – GI # 752 in Appendix B). The Project latitude and longitude are approximately ██████████ ██████████. The Project is Generation Interconnect queue number 752 (GI #752).

██████████ has applied to connect the Project to the IPC distribution system for an injection of 4.2 MW at a single Point of Interconnection (POI) at a 34.5 kV distribution voltage level. The POI evaluated is located in the ██████████ (██████████) 41 distribution circuit boundary approximately 3.4 miles northeast of the ██████████ substation at ██████████.

This report documents the basis for and the results of this system impact study for the GI #752 Generation Interconnection Customer. The report describes the proposed project, the determination of project interconnection feasibility and estimated costs for integration of the Project to the Idaho Power System. This report satisfies the system impact study requirements of the Idaho Power Tariff.

2.0 Summary

The system impact of interconnecting the 4.2 MW Project to IPC's ██████████ substation was evaluated.

The proposed POI provided is in ██████████ 041 feeder service territory.

The addition of 4.2 MW ██████████ Project GI#752 will closely match the load on ██████████ 041 and will require the installation of a deadline check at the substation.

The preliminary power flow analysis indicated that interconnecting the Project to ██████████ 041 will not adversely impact the IPC system with the upgrades detailed in this report. Additionally, Operating Requirements will require the generator to provide leading and lagging reactive power as detailed in section 12.0 of this report.

The Project will be required to control voltage in accordance with a voltage schedule as provided by Idaho Power Grid Operations.

Generator interconnection service, either as an Energy Resource or a Network Resource, does not in any way convey any right to deliver electricity to any specific customer or point of delivery.

The total preliminary cost estimate to interconnect the Project to the primary POI on ██████████ substation is \$473,454 and includes the following tasks:

4.2 MW ██████████ Project

System Impact Study Report

1

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

- Install a four-pole 34.5 kV generation interconnection package at the POI. This includes an SEL-421 protective relay, which requires 3-phase potential transformers (PTs), 3-phase current transformers (CTs), SCADA and remote connectivity. Additionally, a single-phase PT shall be installed on the interconnect customer side of the IPC recloser.
- Install a single-phase PT and wiring for dead-line check on [REDACTED]
- Install Beckwith M2001-D regulator controllers on the [REDACTED] regulator at [REDACTED] substation.
- Replace [REDACTED] line recloser with a model capable of reverse flow control.
- Install a single-phase PT and wiring for dead-line check on [REDACTED] recloser.
- Upgrade the [REDACTED] AMI transformer.
- Customer provided communications for SCADA System.

The cost estimate includes direct equipment and installation labor costs, indirect labor costs and general overheads. These are cost estimates only and final charges to the customer will be based on the actual construction costs incurred. It should be noted that the preliminary cost estimates do not include the cost of the customer's owned equipment to construct the generation site or required communication circuits.

3.0 Scope of Interconnection Transmission System Impact Study

The Interconnection Transmission System Impact Study was completed, in accordance with Idaho Power Company Standard Generator Interconnection Procedures, to provide an evaluation of the system impacts of the interconnection of the proposed generating Project to the Idaho Power system. As listed in the Interconnection Transmission System Impact Study agreement, the Interconnection Transmission System Impact Study report provides the following information:

- identification of additional transformer load tap changer operations, voltage fluctuations (flicker) and additional feeder losses.
- identification of required reactive power support.
- identification of islanding conditions.
- identification of any circuit breaker short circuit capability limits exceeded as a result of the interconnection.
- identification of any thermal overload or voltage limit violations resulting from the interconnection.
- description and non-binding estimated cost of facilities required to interconnect the Small Generating Facility to the IPC System and to address the identified short circuit and power flow issues.

All other proposed generation Projects prior to this Project in the Generator Interconnect queue were considered in this study. A current list of these Projects can be found in the Generation Interconnection folder located on the Idaho Power web site at the link shown below:

4.2 MW [REDACTED] Project

System Impact Study Report

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

<http://www.oatioasis.com/ipco/index.html>.

4.0 Description of Proposed Generating Project

The Project consists of a single POI with 4.2 MW 3 phase [REDACTED] resource and has requested to connect to Idaho Power's 34.5 kV distribution system. [REDACTED] requested that 4.2 MW total injection at the POI be studied.

5.0 Description of Transmission Facilities

The Project is in IPCO's Western load serving area and does not directly impact any monitored transmission path. However, due to its proximity to the Idaho-to-Northwest (WECC Path 14) path, this Transmission System Impact Study was studied with high flows on that path and studied under heavy and light load conditions.

6.0 Description of Power Flow Case

The Project was studied using DNV-GL SynerGEE load flow analysis software to analyze the impact to the [REDACTED] 041 distribution feeder. The Project was studied at peak load and minimum daytime load conditions with all generators on the feeder generating at 100% output.

The Project was also reviewed for potential impacts on the IPC transmission system. This study utilized the following WECC approved cases as the starting point for various scenarios:

- Heavy Load: 25HS4a1
- Light Load: 25LSP1Sa
- High W-E Path 14 Flows (pre-B2H): 25HS4a1
- High W-E Path 14 Flows (post-B2H): 29HS2a1
- High W-E Path 14 Flows (all senior GIs in queue): 24HS3b1
- High E-W Path 14 Flows (all senior GIs in queue): 24LW1a1

The pre-contingency flows across the [REDACTED] path were modeled near its path limit to capture the potential impact of the Project on the existing capabilities of the surrounding paths and the interconnected transmission systems. Performing the studies at these levels ensure that the Total Transfer Capability of the adjacent paths are not impacted by the Project.

The heavy and light load cases were used to study the impact to the local transmission system. The limits used for this analysis are as follows:

1. Voltage magnitude during normal operating steady-state must remain between 0.93 per unit and 1.05 per unit. If the post-transient voltage deviates from this range during N-1 conditions and an operating procedure can be taken to return the voltage to the required range without creating a four-terminal line, then network upgrades are not required.

4.2 MW [REDACTED] Project

System Impact Study Report

3

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

2. Line loading must be less than 100% of line rating during normal steady-state operation. Steady-state line loading above 100% requires network upgrades.
3. Post-transient line overloading that does not exceed the emergency line rating resulting from an N-1 contingency is acceptable if an operating procedure can be taken to reduce the line loading below 100% without creating a four-terminal line.
4. Post-transient line loading above the emergency line rating resulting from an N-1 contingency requires network upgrades.

7.0 Power Flow Analysis Study Results

The distribution modeling studies showed that using #4 ASCR conductor will ensure that voltage requirements should be met at the POI, even during periods of light load and peak Project output.

The impact of the proposed Project on the IPC transmission system was analyzed. Results from the studies performed indicate the addition of the Project, GI #752, will not result in N-1 contingency violations impacting either transmission path or any local transmission system elements.

8.0 Description of Substation Facilities

Idaho Power's [REDACTED] station is located in Malheur County, Idaho. [REDACTED] station is fed by a 69 kV transmission line. The substation transformer feeding [REDACTED] 041, [REDACTED] T-061, is made of [REDACTED] transformers connected delta wye-grounded and is rated for [REDACTED]. [REDACTED] T-061 currently serves two 34.5 kV distribution feeders: [REDACTED] 041 and [REDACTED] 042.

9.0 Description of Distribution Facilities

The Project was studied with a 34.5 kV connection to [REDACTED] 041. This is a grounded-wye feeder operating at 34.5 kV. The Project must have a grounded-wye transformer connection on the IPC side, as well as a wye connection on the Project side of the transformer. There is one feeder recloser on [REDACTED] 041 located between the Project and [REDACTED].

Refer to Appendix A, Section 3, for additional grounding requirements.

10.0 Short Circuit Study Results

○

Fault Study (w/ GINT#752)		
Location	SLG (A)	3PH (A)
@041A FEEDER BREAKER	1624.8	1586.4
@34.5kV POI	960.4	1180.2

Table 1: GI #752 Short Circuit Currents, POI

The protection package would be a standard SEL-421 interconnection relay, setup with a standard 4-pole installation. The 4-pole setup includes a 3-phase PT on the IPC side of the recloser and a single-phase PT on the customer side of the recloser for dead-checking prior to recloser closing. Since the interconnection is greater than 3MW, the protection package will require a remote access communication connection.

Additionally, dead-line check will need to be installed at the [REDACTED] substation for [REDACTED] 041.

The fault current contribution from the Project does not exceed any circuit breaker rating.

11.0 Description of Required Facility Upgrades

The following upgrades will be required to IPC-owned facilities to facilitate the interconnection of GI #752:

- Install a four-pole 34.5 kV generation interconnection package at the POI
 - This includes an SEL-421 protective relay, which requires 3-phase PTs, 3-phase CTs, and remote connectivity
 - Additionally, a single-phase PT shall be installed on the line side of the [REDACTED] 041 feeder at the [REDACTED] substation for deadline check
- Install new load tap changer (LTC) controls on the substation transformer for generation reverse power flow.
- Replace the [REDACTED] recloser with a model that has the capability to accommodate reverse flow and install a single-phase PT for deadline check
- Upgrade the [REDACTED] AMI transformer.

See the conceptual-level cost estimate in Table 1.

4.2 MW [REDACTED] Project

System Impact Study Report

5

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

Item of Work	Estimate
Generation interconnection and protection package	\$ 250,000
Substation upgrades	\$ 60,000
Distribution upgrades	\$ 70,800
Transmission upgrades	\$ 0
Unloaded costs	\$ 380,800
20% Contingency (1)	\$ 76,160
Total unloaded costs	\$ 456,960
Overheads (2)	\$ 16,494
Total Conceptual-level Cost Estimate in 2025 dollars (3)	\$ 473,454

Table 2: Conceptual-level Primary POI Cost Estimate for GI #752

(1) This cost estimate does not include any contingency to cover unknown events and occurrences or any changed circumstances. Idaho Power typically applies a contingency that ranges from 10-30% of the project cost, depending on the intricacies of the project and the status of the design, but no such amount is included in this cost estimate. Actual costs could deviate from the estimate.

(2) Overhead costs cover the indirect costs associated with the Project.

(3) This cost estimate includes direct equipment, material, labor, overheads, and contingency as shown.

- Note that this estimate does not include the cost of the customer's equipment/facilities.
- Note that the overhead rates are subject to change during the year.
- These are estimated costs only and final charges to the customer will be based on the actual construction costs incurred.
- These are non-binding conceptual level cost estimates that will be further refined upon the request and completion of Transmission and Distribution Facility Studies.

4.2 MW [REDACTED] Project

System Impact Study Report

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

12.0 Description of Operating Requirements

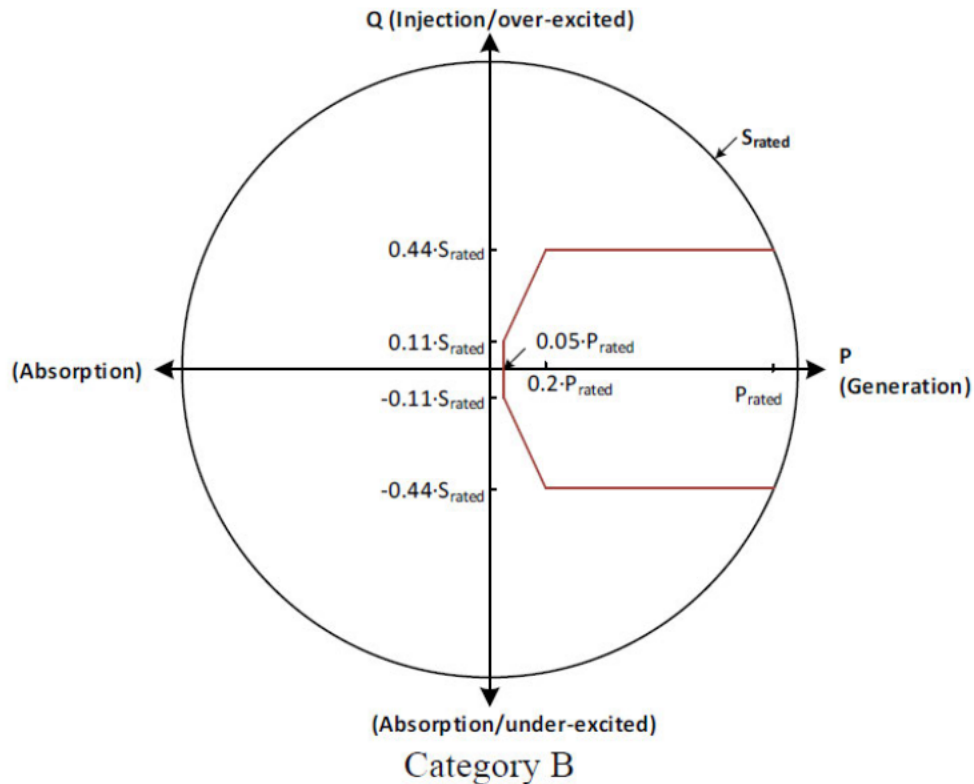


Figure 1: Operating Requirements (IEEE 1547-2018)

The Project will be required to control voltage at the Project POI in accordance with a voltage schedule provided by Idaho Power Grid Operations. The Project will be required to follow a voltage-reactive power characteristic curve as shown in Figure 2 with the settings shown in Table 2. Therefore, GI #752 will be required to install a plant controller for managing the real and reactive power output of the 4.2 MW [REDACTED] at the Project POI. The maximum injecting reactive power required will be 1.848 MVAR (44%, injecting) and the maximum absorbing reactive power required will be 1.848 MVAR (44%, absorbing).

4.2 MW [REDACTED] Project

System Impact Study Report

7

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

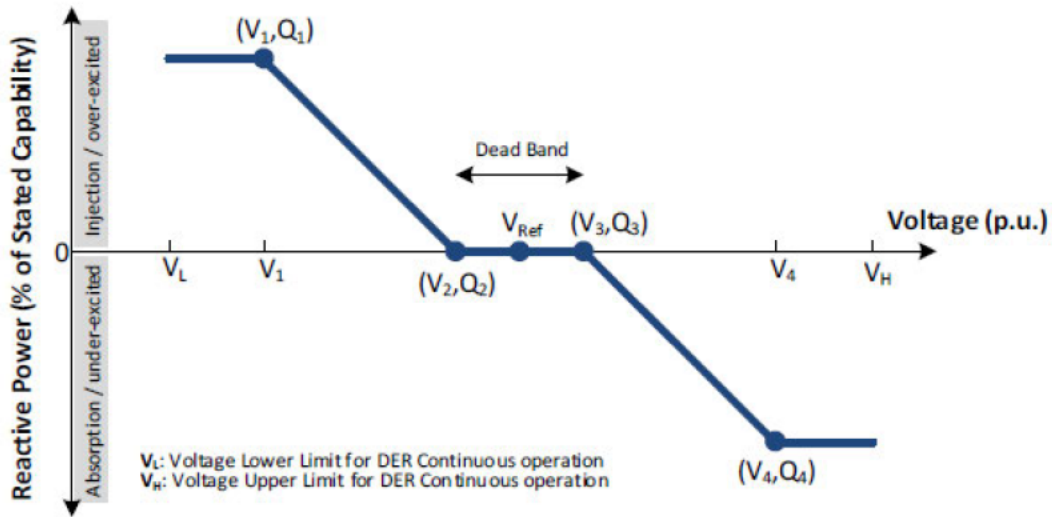


Figure 2. Voltage-Reactive Power Settings (IEEE 1547-2018)

Table 3: Voltage-Reactive Power Settings for GI #752 (1)

Set Point	V (per unit nominal voltage)	Set Point	Q (per unit)
V_1	0.92	Q_1	44%, injecting
V_2	0.98	Q_2	0
V_3	1.03	Q_3	0
V_4	1.06	Q_4	44%, absorption

(1) Open-loop response time – 5 seconds

Voltage flicker at startup and during operation will be limited to less than 5% as measured at the POI. The allowable voltage flicker limit is further reduced during operation due to multiple voltage fluctuations per hour or minute, per Idaho Power’s T&D Advisory Information Manual.

The Project is required to comply with the applicable voltage fluctuation limits found in IEEE Standard 1453-2022 *IEEE Recommended Practice for Measurement and Limits of Voltage Fluctuations and Associated Light Flicker on AC Power Systems*.

The Project is required to comply with the applicable Voltage and Current Distortion Limits found in IEEE Standard 519-2022 *IEEE Standard for Harmonic Control in Electrical Power Systems*.

4.2 MW [REDACTED] Project

System Impact Study Report

OFFICIAL USE ONLY

This report contains Idaho Power Company Critical Energy Infrastructure Information (CEII). Distribution of this report must be limited to parties that have entered into a non-disclosure agreement with Idaho Power Company and have a need to know.

13.0 Conclusion

The requested interconnection of the [REDACTED] Project, GI #752, to Idaho Power's system was studied. The Project will interconnect to [REDACTED] 041 feeder at the [REDACTED] distribution voltage level.

The results of this study confirm that GI #752, [REDACTED] will not adversely impact the IPC system with the upgrades detailed in this report. A four-pole generation interconnect package at the POI, a line recloser upgrade with deadline check at [REDACTED] substation transformer LTC upgrade, and deadline check at the [REDACTED] substation are required to integrate the 4.2 MW project. Operating Requirements will require the generator to provide leading and lagging reactive power as detailed in section 12.0 of this report.

All generation Projects in the area ahead of the Project in the IPC generation interconnection queue and their associated transmission system improvements were included in this study.

The estimated cost to interconnect GI #752 to the IPC system at the [REDACTED] 041 feeder at the 34.5 kV point of interconnection considered in this study is approximately \$473,454 at the POI.

Generator interconnection service, either as an Energy Resource or a Network Resource, does not in any way convey any right to deliver electricity to any specific customer or point of delivery. Transmission requirements to integrate the Project will be determined during the System Impact Study phase of the generator interconnection process.

APPENDIX A

A-1.0 Method of Study

The Transmission System Impact Study plan inserts the Project up to the maximum requested injection into the selected Western Electricity Coordinating Council (WECC) power flow case and then, using Power World Simulator or GE's Positive Sequence Load Flow (PSLF) analysis tool, examines the impacts of the new resource on Idaho Power's transmission system (lines, transformers, etc.) within the study area under various operating and outage scenarios. The WECC and Idaho Power reliability criteria and Idaho Power operating procedures were used to determine the acceptability of the configurations considered. The WECC case is a recent case modified to simulate stressed but reasonable pre-contingency energy transfers utilizing the IPC system. For distribution feeder analysis, Idaho Power utilizes DNV·GL's SynerGEE Electric software.

A-2.0 Acceptability Criteria

The following acceptability criteria were used in the power flow analysis to determine under which system configuration modifications may be required:

The continuous rating of equipment is assumed to be the normal thermal rating of the equipment. This rating will be as determined by the manufacturer of the equipment or as determined by Idaho Power. Less than or equal to 100% of continuous rating is acceptable.

Idaho Power's Voltage Operating Guidelines were used to determine voltage requirements on the system. This states that, in part, distribution voltages, under normal operating conditions, are to be maintained within plus or minus 5% (0.05 per unit) of nominal at each meter or POI on the feeder. Therefore, voltages greater than or equal to 0.95 pu voltage and less than or equal to 1.05 pu voltage are acceptable.

Voltage flicker during the starting or stopping of the generator will be limited to less than 5% as measured at the POI. Allowable voltage flicker limit is further reduced during operation due to multiple voltage fluctuations per hour or minute, per Idaho Power's T&D Advisory Information Manual.

Idaho Power's Reliability Criteria for System Planning was used to determine proper transmission system operation.

All customer generation must meet IEEE 519, IEEE1453, IEEE1547, and ANSI C84.1 Standards.

All other applicable national and Idaho Power standards and prudent utility practices were used to determine the acceptability of the configurations considered.

The stable operation of the system requires an adequate supply of volt-amperes reactive (VARs) to maintain a stable voltage profile under both steady-state and dynamic system conditions. An inadequate supply of VARs will result in voltage decay or even collapse under the worst conditions.

Equipment/line/path ratings used will be those that are in use at the time of the study or that are represented by IPC upgrade Projects that are either currently under construction or whose budgets have been approved for construction in the near future. All other potential future ratings are outside the scope of this study. Future transmission changes may, however, affect current facility ratings used in the study.

A-3.0 Grounding Guidance

IPC requires interconnected transformers on the distribution system to limit their ground fault current to 20 amps at the Point of Interconnection.

A-4.0 Electrical System Protection Guidance

IPC requires electrical system protection per Requirements for Generation Interconnections found on the Idaho Power Web site,

<https://docs.idahopower.com/pdfs/BusinessToBusiness/FacCommReq.pdf>

A-5.0 WECC Coordinated Off-Nominal Frequency Load Shedding and Restoration Requirements

IPC requires frequency operational limits to adhere to WECC Under-frequency and Over-frequency Limits per the WECC Coordinated Off-Nominal Frequency Load Shedding and Restoration Requirements available upon request.

APPENDIX B

B-1.0 [REDACTED] Project GI #752 Site Locations



Figure 3. Location of [REDACTED] Project – GI #752